




## UL Listed Facility Filters Per UL Safety Specification 1283

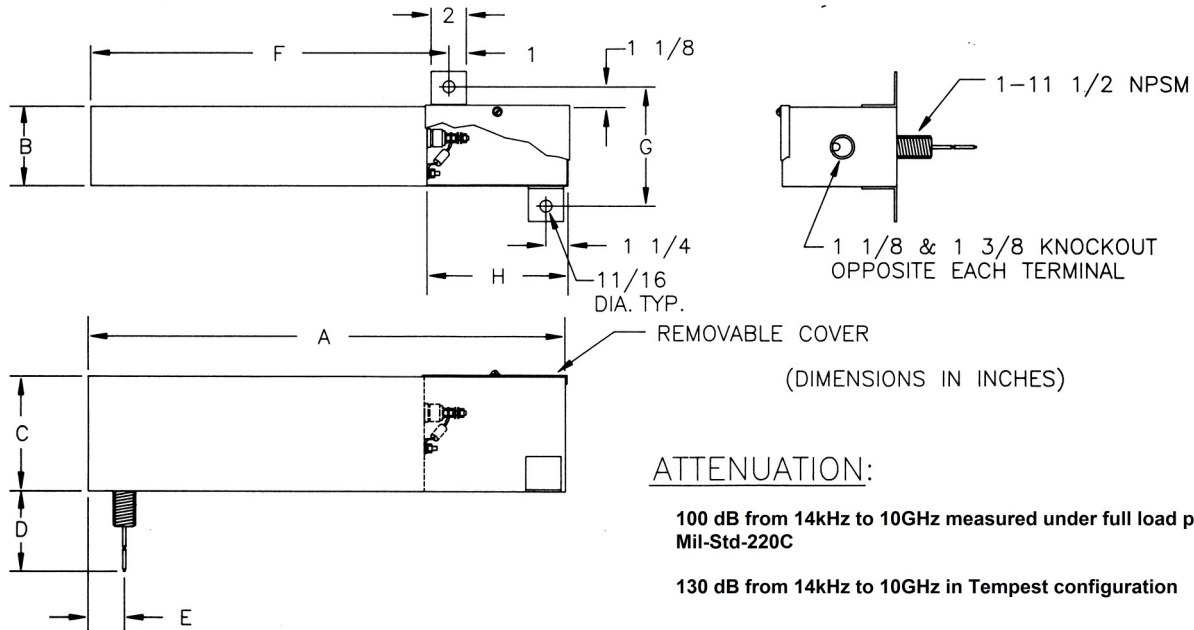

PART NO	CURRENT RATING (AMP)	VOLTAGE RATING (VAC)	FREQ RATING (HZ)	WIRE SIZE	DIMENSIONS (INCHES)							
					A	B	C	D	E	F	G	H
FC-962	2 x 5	277	0-60	#10	24	7	4	36	1.75	19.25	9.25	6
FC-962A	2 x 5	277	0-400	#10	24	7	4	36	1.75	19.25	9.25	6
FC-1407	2 x 5	600	0-60	#10	24	8	7	36	1.75	19.25	10.25	6
FC-1407A	2 x 5	600	0-400	#10	24	8	7	36	1.75	19.25	10.25	6
FC-943	2 x 30	277	0-60	#10	24	7	7	36	1.75	19.25	9.25	6
FC-943A	2 x 30	277	0-400	#10	24	7	7	36	1.75	19.25	9.25	6
FC-1387	2 x 30	600	0-60	#10	24	8	7	36	1.75	19.25	10.25	6
FC-1387A	2 x 30	600	0-400	#10	24	8	7	36	1.75	19.25	10.25	6
FC-944	100	277	0-60	#2	34	4.50	6.50	36	2	26.25	6.75	9
FC-944A	100	277	0-400	#2	34	4.50	6.50	36	2	26.25	6.75	9
FC-1197	100	600	0-60	#2	34	8	6.50	36	2	26.25	10.25	9
IEC-1197A	100	600	0-400	#2	34	8	6.50	36	2	26.25	10.25	9
FC-945	225	277	0-60	4/0	41	8	8	36	2	27.25	10.25	15
FC-945A	225	277	0-400	4/0	41	8	8	36	2	27.25	10.25	15
FC-1198	225	600	0-60	4/0	41	8	8	36	2	27.25	10.25	15
FC-1198A	225	600	0-400	4/0	41	8	8	36	2	27.25	10.25	15

1. Each field wiring terminal and ground stud is provided with a set screw type lug
2. Each circuit is provided with discharge resistors
3. Each filter available in tempest configuration
4. Each filter is provided with non-flammable impregnant as classified by U.L. and MIL-F-15733

FIL-COIL, FC INC—THE FIRST  
COMPANY TO BE LISTED AS MANUFACTURER OF  
FACILITY FILTERS PER UL SAFETY SPECIFICATION #1283

